



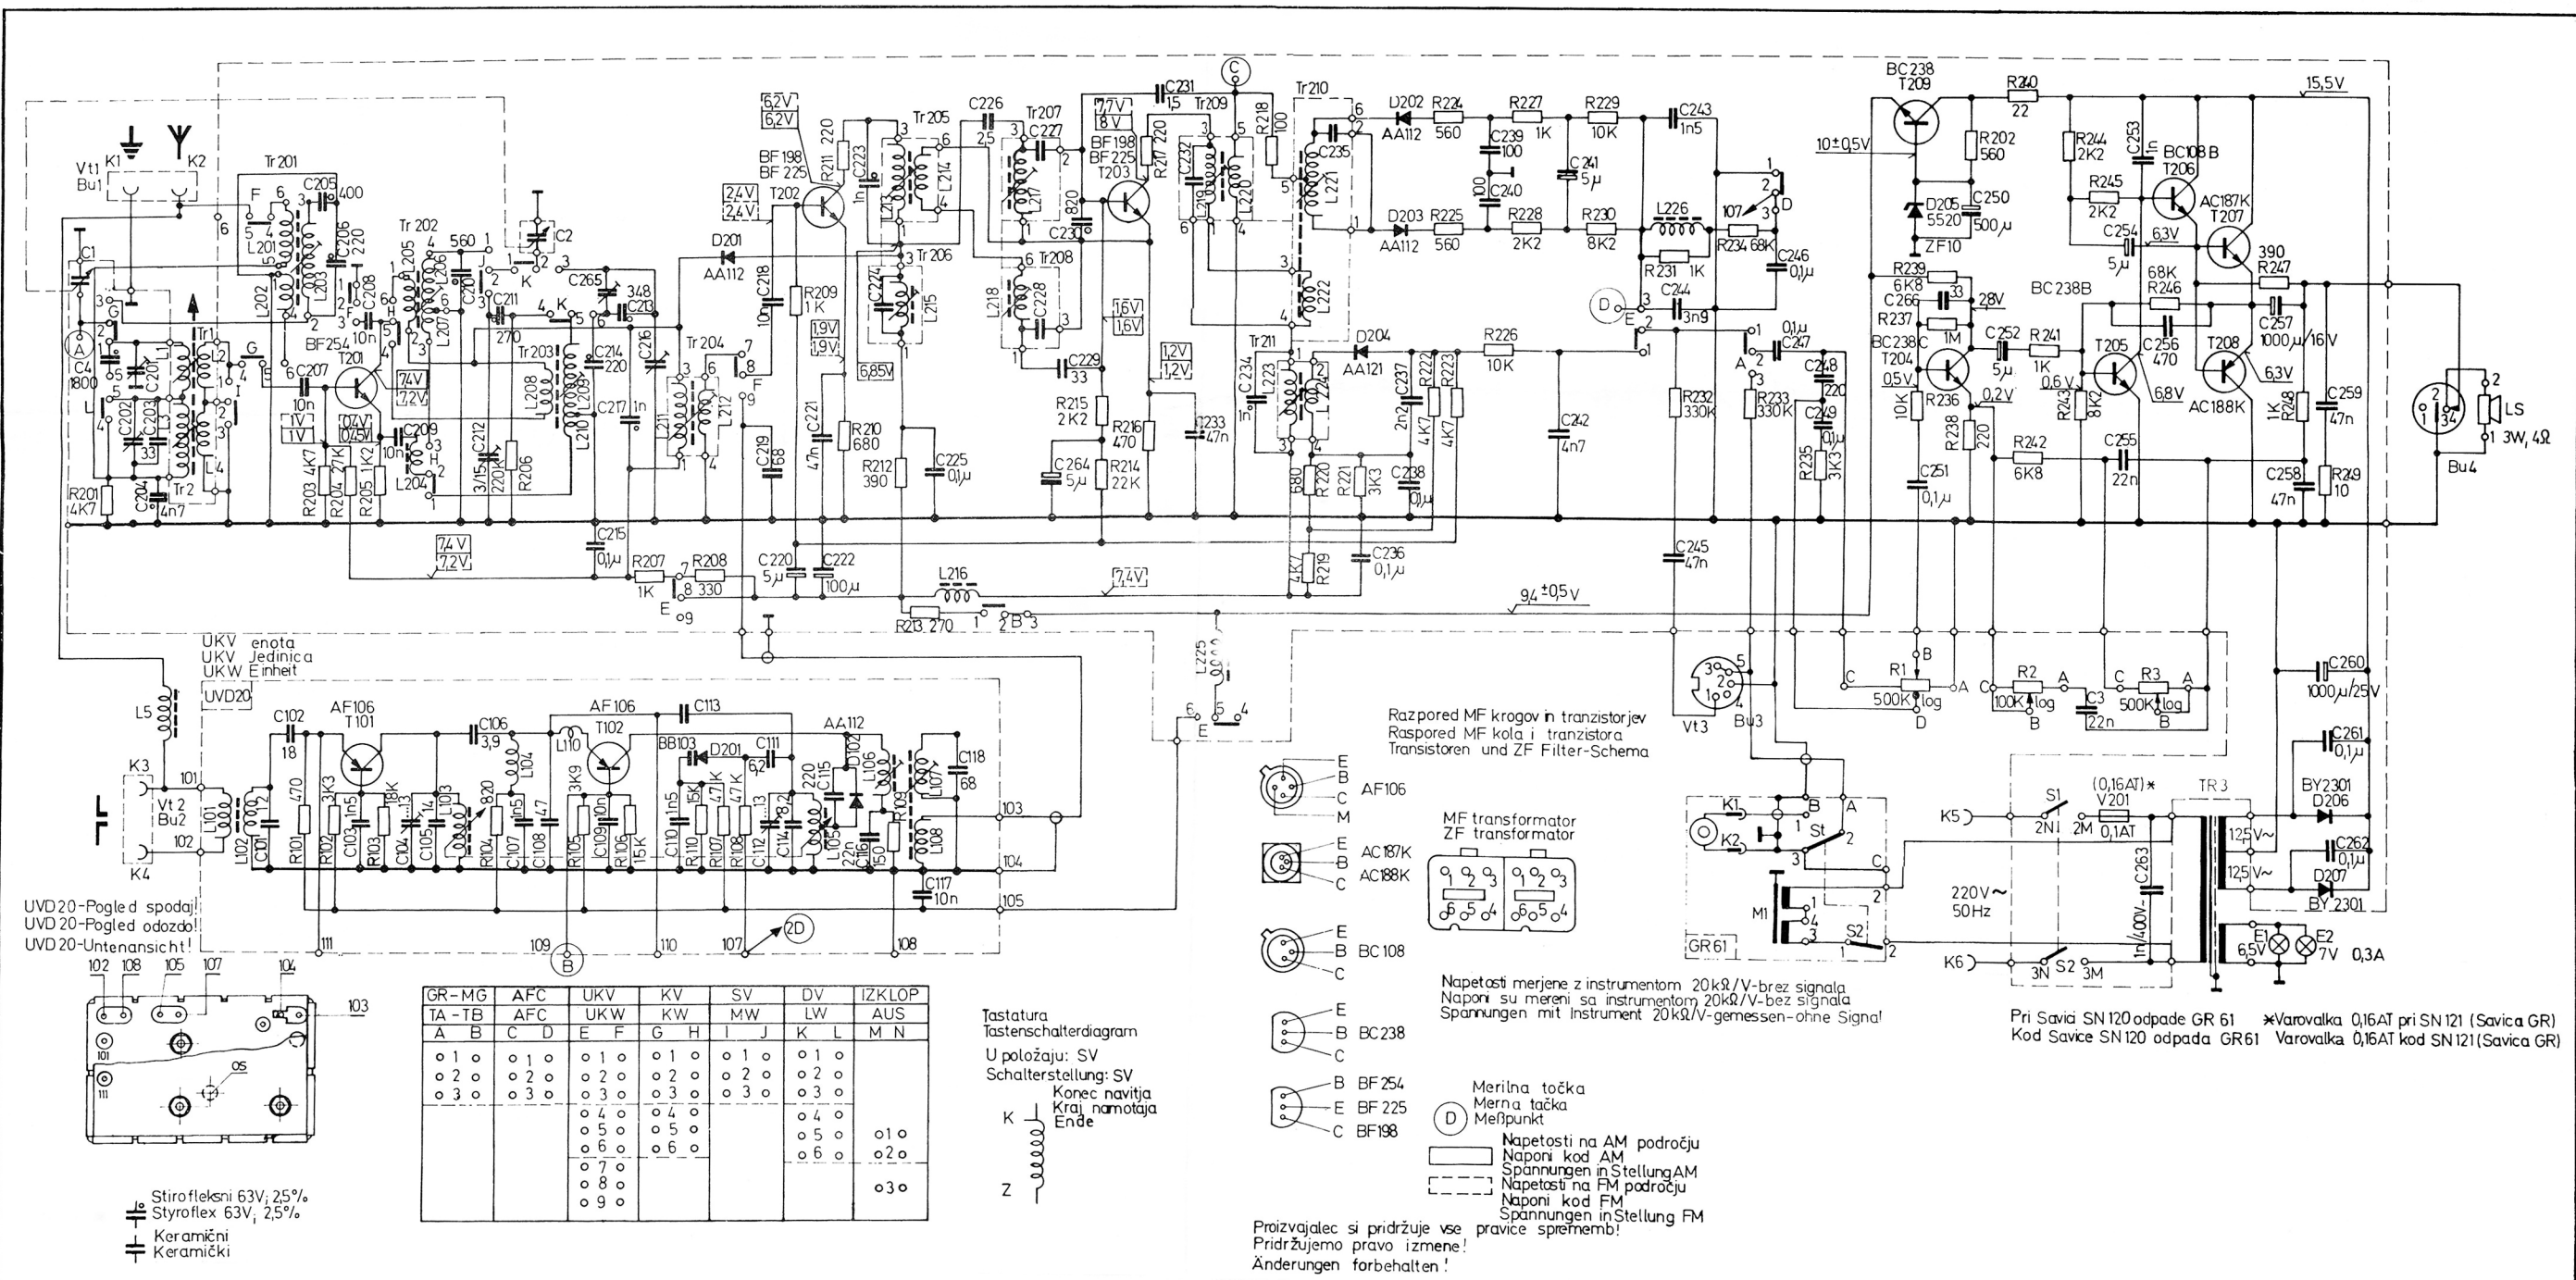


UKV enota
UKV Jedinica
UKW Einheit

UVD20-Pogled spodaj!
UVD 20-Pogled ododo!
UVD 20-Untenansicht!

GR-MG		AFC	UKV	KV	SV	DV	IZKLOP	
TA	TB	AFC	UKW	KW	MW	LW	AUS	
A	B	C	D	E	F	G	H	I
1	0	1	0	1	0	1	0	1
2	0	2	0	2	0	2	0	2
3	0	3	0	3	0	3	0	3
		4	0	4	0	4	0	4
		5	0	5	0	5	0	5
		6	0	6	0	6	0	6
		7	0					01
		8	0					02
		9	0					03



Razpored MF krogov in tranzistorjev
Raspored MF kola i tranzistora
Transistoren und ZF Filter-Schema



Napetosti merjene z instrumentom 20kΩ/V-bez signala
Naponi su mereni sa instrumentom 20kΩ/V-bez signala
Spannungen mit Instrument 20kΩ/V-gemessen-ohne Signal!

Merilna točka
Merna tačka
Meßpunkt

Napetosti na AM področju
Naponi kod AM
Spannungen in Stellung AM

Napetosti na FM področju
Naponi kod FM
Spannungen in Stellung FM

Pri Savici SN 120 odpada GR 61 *Varovalka 0,16AT pri SN 121 (Savica GR)
Kod Savice SN 120 odpada GR 61 Varovalka 0,16AT kod SN 121 (Savica GR)